


Lecture 12: Internal Model Control

- ▶ Youla Parametrization
- ▶ Internal Model Control
- ▶ Dead Time Compensation

Section 8.4 in Glad/Ljung.

The Youla Parametrization

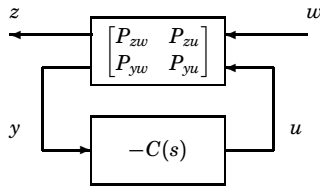

The closed loop transfer matrix from w to z is

$$G_{zw}(s) = P_{zw}(s) - P_{zu}(s)Q(s)P_{yw}(s)$$


where

$$Q(s) = C(s)[I + P_{yu}(s)C(s)]^{-1}$$

$$C(s) = Q(s) + Q(s)P_{yu}(s)C(s)$$


$$C(s) = [I - Q(s)P_{yu}(s)]^{-1}Q(s)$$

Closed loop stability for unstable plants

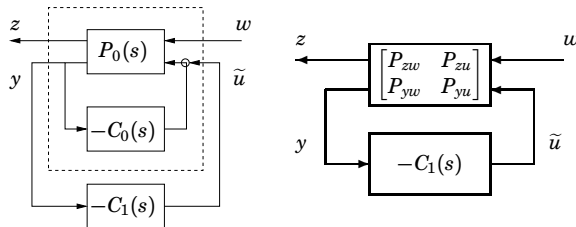

In case $P_0(s)$ is unstable, let $C_0(s)$ be a stabilizing controller. Then the previous argument can be applied with P_{zw} , P_{zu} and P_{yw} representing the stabilized closed loop system.

Example — DC-motor

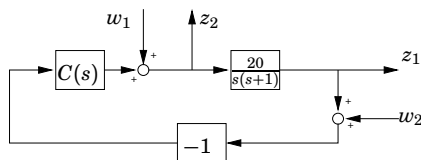


The transfer matrix from (w_1, w_2) to (z_1, z_2) is

$$G_{zw}(s) = \begin{bmatrix} \frac{P}{1+PC} & \frac{-PC}{1+PC} \\ \frac{1}{1+PC} & \frac{-C}{1+PC} \end{bmatrix}$$

where $P(s) = \frac{20}{s(s+1)}$. How should we choose stable P_{zw} , P_{zu} , P_{yw} and Q to get


$$G_{zw}(s) = P_{zw}(s) - P_{zu}(s)Q(s)P_{yw}(s) \quad ?$$

The Q -parametrization (Youla)

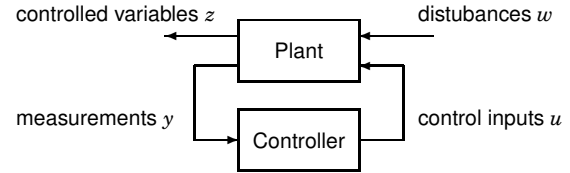

Idea for lecture 12-14:

The choice of controller generally corresponds to finding $Q(s)$, to get desirable properties of the map from w to z :



Once $Q(s)$ is determined, a corresponding controller is found.

Closed loop stability for stable plants

Suppose the original plant P is stable. Then

- ▶ Stability of $Q(s)$ implies stability of $P_{zw}(s) - P_{zu}(s)Q(s)P_{yw}(s)$
- ▶ If $Q = C[I + P_{yu}C]^{-1}$ is unstable, then small measurement errors gives unbounded input errors.


Next lecture: Synthesis by convex optimization

A general control synthesis problem can be stated as a convex optimization problem in the variable $Q(s)$. The problem could have a quadratic objective, with linear/quadratic constraints:

$$\begin{aligned} & \text{Minimize} \quad \int_{-\infty}^{\infty} |P_{zw}(i\omega) + P_{zu}(i\omega) \sum_k Q_k \phi_k(i\omega) P_{yw}(i\omega)|^2 d\omega \quad \text{quadratic objective} \\ & \text{subject to} \quad \left. \begin{array}{l} \text{step response } w_i \rightarrow z_j \text{ is smaller than } f_{ijk} \text{ at time } t_k \\ \text{step response } w_i \rightarrow z_j \text{ is bigger than } g_{ijk} \text{ at time } t_k \end{array} \right\} \text{linear constraints} \\ & \quad \quad \quad \left. \begin{array}{l} \text{Bode magnitude } w_i \rightarrow z_j \text{ is smaller than } h_{ijk} \text{ at } \omega_k \end{array} \right\} \text{quadratic constraints} \end{aligned}$$

Once the variables Q_0, \dots, Q_m have been optimized, the controller is obtained as $C(s) = [I - Q(s)P_{yu}(s)]^{-1}Q(s)$

Stabilizing nominal feedback for DC-motor

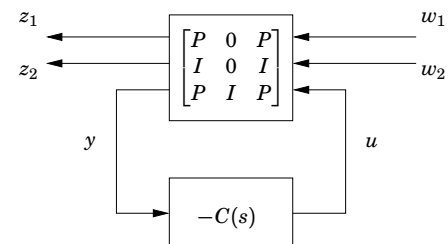


The plant $P(s) = \frac{20}{s(s+1)}$ is not stable, so write

$$C(s) = C_0(s) + C_1(s)$$

where $C_0(s) \equiv 1$ is a stabilizing controller.

Redraw diagram for DC motor example

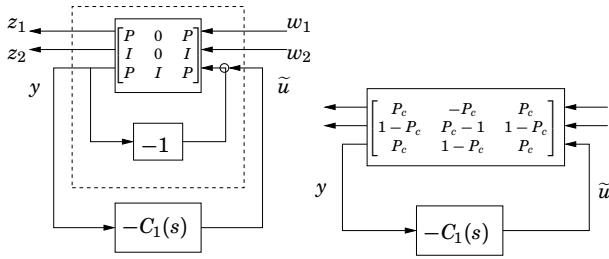


$$y = Pw_1 + w_2 + P(\tilde{u} - y) \Rightarrow y = P_c w_1 + (1 - P_c)w_2 + P_c \tilde{u}$$

$$z_1 = y - w_2 \Rightarrow z_1 = P_c w_1 - P_c w_2 + P_c \tilde{u}$$

$$z_2 = w_1 + u = w_1 - y + \tilde{u} \Rightarrow z_2 = (1 - P_c)(w_1 - w_2 + \tilde{u})$$

where $P_c = (1 + P)^{-1}P = \frac{20}{s^2 + s + 20}$ is stable.

Internal Model Control

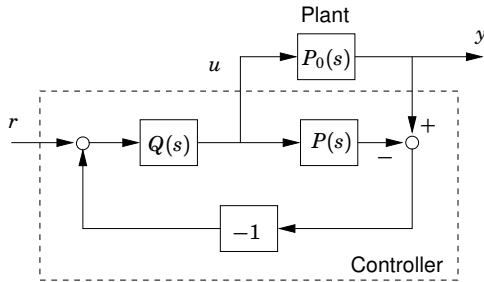

Feedback is used only as the real process deviates from $P(s)$.

The transfer function $Q(s)$ defines how the desired input depends on the reference signal.

When $P = P_0$, the transfer function from r to y is $P(s)Q(s)$.

Internal Model Control — Strictly proper plants

When $P = P_0$, the transfer function from r to y is $P(s)Q(s)$.

Hence, ideally, one would like to put $Q(s) = P(s)^{-1}$. For several reasons this is not possible for accurate process models:

- ▶ If $P(s)$ is strictly proper, the inverse would have more zeros than poles. Alternatively, one could choose

$$Q(s) = \frac{1}{(\lambda s + 1)^n} P(s)^{-1}$$

where n is large enough to make Q proper. The parameter λ influences the speed of control.

Example 1 — First order plant model

$$P(s) = \frac{1}{\tau s + 1}$$

$$Q(s) = \frac{1}{\lambda s + 1} P(s)^{-1} = \frac{\tau s + 1}{\lambda s + 1}$$


$$C(s) = \frac{Q(s)}{1 - Q(s)P(s)} = \frac{\frac{\tau s + 1}{\lambda s + 1}}{1 - \frac{1}{\lambda s + 1}} = \frac{\tau}{\lambda} \left(1 + \frac{1}{s\tau} \right)$$

PI controller

Outline

- Youla Parametrization
- **Internal Model Control**
- Dead Time Compensation

Two equivalent diagrams

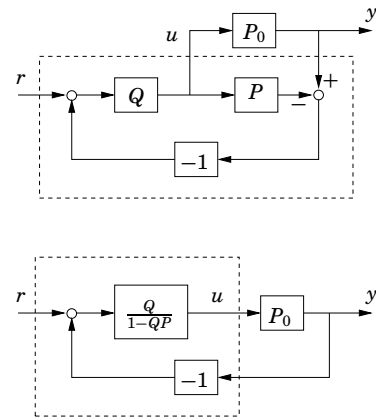

Internal Model Control — Zeros and delays

Once again, ideally, one would like to put $Q(s) = P(s)^{-1}$.

Here are other reasons why this is often not possible:

- ▶ If $P(s)$ has unstable zeros, the inverse would be unstable. Alternatively, one could either remove every unstable factor $(-\beta s + 1)$ from the plant numerator before inverting, or replace it by $(\beta s + 1)$. With the latter alternative, only the phase is modified, not the amplitude function.
- ▶ If $P(s)$ includes a time delay, its inverse would have to predict the future. Instead, the time delay is removed before inverting.

Example 2 — Non-minimum phase plant

$$P(s) = \frac{-\beta s + 1}{\tau s + 1}$$

$$Q(s) = \frac{(-\beta s + 1)}{(\beta s + 1)} P(s)^{-1} = \frac{\tau s + 1}{\beta s + 1}$$


$$C(s) = \frac{Q(s)}{1 - Q(s)P(s)} = \frac{\frac{\tau s + 1}{\beta s + 1}}{1 - \frac{(-\beta s + 1)}{(\beta s + 1)}} = \frac{\tau}{2\beta} \left(1 + \frac{1}{s\tau} \right)$$

PI controller

Outline

- Youla Parametrization
- Internal Model Control
- **Dead Time Compensation**


Dead Time Compensation

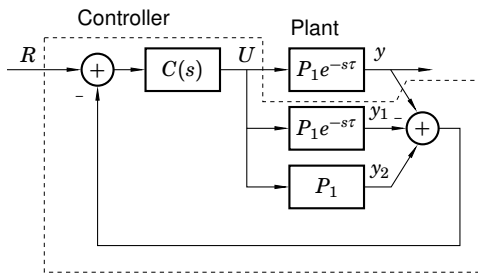

Idea: Make an internal model of the process (with and without the delay) in the controller. Ideally Y and Y_1 cancel each other and use feedback from Y_2 "without delay".

Youla parametrization revisited

The Youla-parametrization:



where C_{nom} stabilizes the $[P, C]$ -system and $Q(z)$ is any stable transfer function.

Summary of Internal Model Control

- ▶ $Q(s)$ can be designed by hand for simple plants
- ▶ Ideas applicable also to multivariable plants
- ▶ Warning:
Cancellation of slow poles gives poor disturbance rejection

Dead Time Compensation

Consider the plant model

$$P(s) = P_1(s)e^{-s\tau}$$

Let $C_0 = Q/(1 - QP_1)$ be the controller we would have used without delays. Then $Q = C_0/(1 + C_0P_1)$.

The rule of thumb tell us to use the same Q also for systems with delays. This gives


$$C(s) = \frac{Q(s)}{1 - Q(s)P_1(s)e^{-s\tau}} = \frac{C_0/(1 + C_0P_1)}{1 - e^{-s\tau}P_1C_0/(1 + C_0P_1)}$$

$$C(s) = \frac{C_0(s)}{1 + (1 - e^{-s\tau})C_0(s)P_1(s)}$$

This modification of the $C_0(s)$ to account for time delays is known as dead time compensation according to Otto Smith.


Example: Dead Time Compensation

Otto Smith compensator (thick) and standard PI controller (thin)

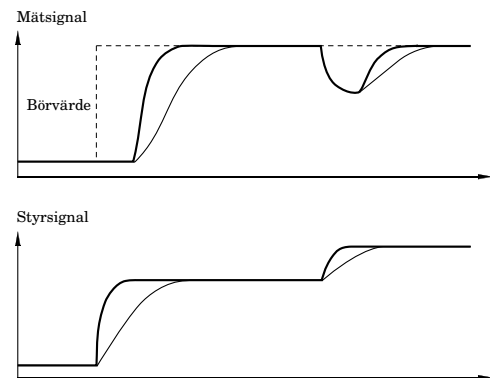

Nominal Controller

Linear system with observer

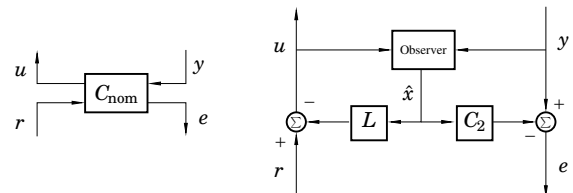

In equations

$$\dot{\hat{x}} = A\hat{x} + Bu(k) + Ke(k)$$

$$u = r - L\hat{x}$$

$$e = y - C\hat{x}$$