

Lecture 8: Multivariable and Decentralized Control

- Transfer functions for MIMO-systems
 - vehicles
 - power network
 - process control industry
- Limitations due to unstable multivariable zeros
- Decentralized/decoupled control by pairing of signals
- Short warning on integral action in parallel systems

See "Lecture notes" and [G&L, Ch. 1 and 8.1–8.3]

Example MIMO-system: A Distillation Column

Example: Distillation column: raw oil inserted at bottom → different petro-chemical subcomponents extracted

$$\begin{bmatrix} Y_1(s) \\ Y_2(s) \end{bmatrix} = \underbrace{\begin{bmatrix} \frac{4}{50s+1}e^{-27s} & \frac{1.8}{60s+1}e^{-28s} & \frac{5.9}{50s+1}e^{-27s} \\ \frac{5.4}{50s+1}e^{-18s} & \frac{5.7}{60s+1}e^{-14s} & \frac{6.9}{40s+1}e^{-15s} \end{bmatrix}}_{P(s)} \begin{bmatrix} U_1(s) \\ U_2(s) \\ U_3(s) \end{bmatrix}$$

Outputs:

y_1 = top draw composition
 y_2 = side draw composition

Inputs:

u_1 = top draw flowrate
 u_2 = side draw flowrate
 u_3 = bottom temperature control input

Sensitivity functions for MIMO-systems

Output sensitivity function

$$S = (I + PC)^{-1}$$

$G_{? \rightarrow ?}$

Input sensitivity function

$$(I + CP)^{-1}$$

$G_{? \rightarrow ?}$

Complementary sensitivity function

$$T = (I + PC)^{-1}PC$$

$G_{? \rightarrow ?}$

1-minute problem:

Find the transfer functions above in the block diagram on the previous slide. (Extra: What are the dimensions?)

Lecture 8: Multivariable and Decentralized Control

- Transfer functions for MIMO-systems
- Limitations due to unstable multivariable zeros
- Decentralized/decoupled control by pairing of signals
- Short warning on integral action in parallel systems

Typical Process Control System


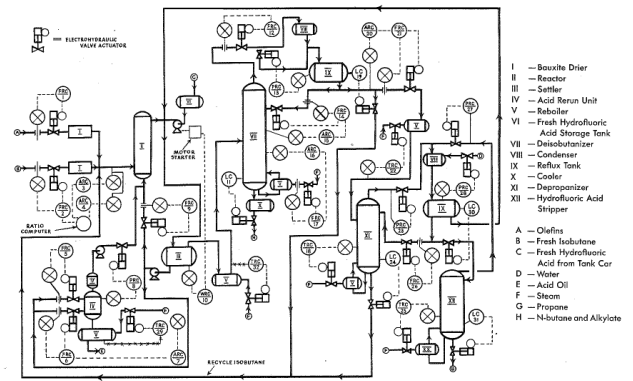


Figure 13-6. Automatic control system for Perco motor fuel alkylation process.

Multivariable transfer functions

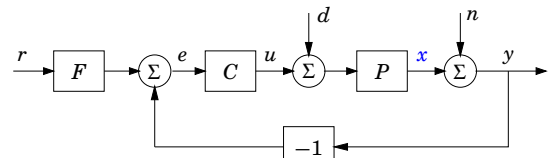

Order matters!!

$$\begin{aligned} X(s) &= PCF \cdot R(s) + P \cdot D(s) - PC \cdot [N(s) + X(s)] \\ [I + PC]X(s) &= PCF \cdot R(s) + P \cdot D(s) - PC \cdot N(s) \end{aligned}$$

$$X(s) = [I + PC]^{-1} \cdot (PCF \cdot R(s) + P \cdot D(s) - PC \cdot N(s))$$

Notice that $[I + PC]^{-1}$ is generally not the same as $[I + CP]^{-1}$.

Some useful math relations

Notice the following identities:

- $[I + PC]^{-1}P = P[I + CP]^{-1}$
- $C[I + PC]^{-1} = [I + CP]^{-1}C$
- $T = P[I + CP]^{-1}C = PC[I + PC]^{-1} = [I + PC]^{-1}PC$
- $S + T = I$

Proof:

The first equality follows by multiplication on both sides with $(I + PC)$ from the left and with $(I + CP)$ from the right.

$$\text{Left: } [I + PC][I + PC]^{-1}P[I + CP] = I \cdot [P + PCP] = [I + PC]P$$

$$\text{Right: } [I + PC]P[I + CP]^{-1}[I + CP] = [I + PC]P \cdot I = [I + PC]P$$

–“Push through and keep track of order”

Limitations due to unstable zeros

For a multivariable system with square transfer matrix $P(s)$, i.e. the same number of inputs and outputs, the zeros can be defined as the poles of $P(s)^{-1}$. The following theorem captures the influence of an unstable zero:

Theorem

Let $W_S(s)$ be stable and let $S(s) = [I + P(s)C(s)]^{-1}$ be the sensitivity function of a stable closed loop system. Then, the specification

$$\|W_S S\|_{\infty} \leq 1$$

is impossible to satisfy unless $\|W_S(z)\| \leq 1$ for every unstable zero z of $P(s)$.

Non-minimum phase MIMO System

Example [G&L, Ch 1]

Consider a feedback system $Y(s) = (I + PC)^{-1} \cdot R(s)$ with the multivariable process

$$P(s) = \begin{bmatrix} \frac{2}{s+1} & \frac{3}{s+2} \\ \frac{1}{s+1} & \frac{1}{s+1} \end{bmatrix}$$

Computing the determinant

$$\det P(s) = \frac{2}{(s+1)^2} - \frac{3}{(s+2)(s+1)} = \frac{-s+1}{(s+1)^2(s+2)}$$

shows that the process has an unstable zero at $s = 1$, which will limit the achievable performance.

See lecture notes for details of the following slides (checking three different controllers)

Step responses using controller 1

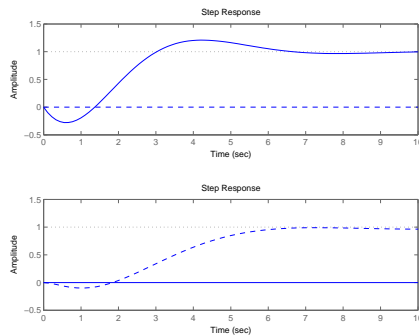


Figure: Closed loop step responses with decoupling controller $C_1(s)$ for the two outputs y_1 (solid) and y_2 (dashed). The upper plot is for a reference step for y_1 . The lower plot is for a reference step for y_2 .

Step responses using controller 2

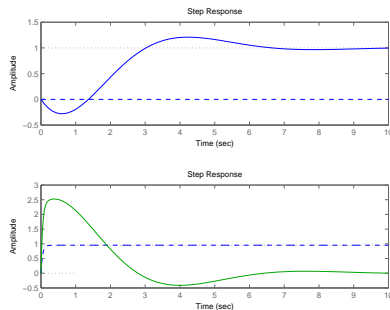


Figure: Closed loop step responses with controller $C_2(s)$ for the two outputs y_1 (solid) and y_2 (dashed). The right half plane zero does not prevent a fast y_2 -response to r_2 but at the price of a simultaneous undesired response in y_1 .

Step responses using controller 3

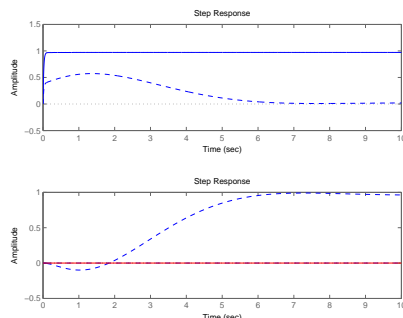


Figure: Closed loop step responses with controller $C_3(s)$ for the two outputs y_1 (solid) and y_2 (dashed). The right half plane zero does not prevent a fast y_1 -response to r_1 but at the price of a simultaneous undesired response in y_2 .

Example — controller 1

The controller

$$C_1(s) = \begin{bmatrix} \frac{K_1(s+1)}{s} & -\frac{3K_2(s+0.5)}{s(s+2)} \\ -\frac{K_1(s+1)}{s} & \frac{2K_2(s+0.5)}{s(s+1)} \end{bmatrix}$$

gives the diagonal loop transfer matrix

$$P(s)C_1(s) = \begin{bmatrix} \frac{K_1(-s+1)}{s(s+2)} & 0 \\ 0 & \frac{K_2(s+0.5)(-s+1)}{s(s+1)(s+2)} \end{bmatrix}$$

Hence the system is decoupled into to scalar loops, each with an unstable zero at $s = 1$ that limits the bandwidth.

The closed loop step responses are shown in Figure ??.

Example – controller 2

The controller

$$C_2(s) = \begin{bmatrix} \frac{K_1(s+1)}{s} & K_2 \\ -\frac{K_1(s+1)}{s} & K_2 \end{bmatrix}$$

gives the diagonal loop transfer matrix

$$P(s)C_2(s) = \begin{bmatrix} \frac{K_1(-s+1)}{s(s+2)} & \frac{K_2(5s+7)}{(s+2)(s+1)} \\ 0 & \frac{2K_2}{s+1} \end{bmatrix}$$

Now the **decoupling is only partial**:

Output y_2 is not affected by r_1 . Moreover, there is no unstable zero that limits the rate of response in y_2 !

The closed loop step responses for $K_1 = 1$, $K_2 = 10$ are shown in Figure ??.

Example – controller 3

The controller

$$C_3(s) = \begin{bmatrix} K_1 & -\frac{K_2(s+0.5)}{s(s+2)} \\ K_1 & \frac{2K_2(s+0.5)}{s(s+1)} \end{bmatrix}$$

gives the diagonal loop transfer matrix

$$P(s)C_3(s) = \begin{bmatrix} \frac{K_1(5s+7)}{(s+1)(s+2)} & 0 \\ \frac{2K_1}{s+1} & \frac{K_2(-1+s)(s+0.5)}{s(s+1)^2(s+2)} \end{bmatrix}$$

In this case y_1 is decoupled from r_2 and can respond arbitrarily fast for high values of K_1 , at the expense of bad behavior in y_2 . Step responses for $K_1 = 10$, $K_2 = -1$ are shown in Figure ??.

Example — summary

To summarize, the example shows that even though a **multivariable unstable zero always gives a performance limitation**, it is **possible to influence** where the effects should show up.

Lecture 8: Multivariable and Decentralized Control

- ▶ Transfer functions for MIMO-systems
- ▶ Limitations due to unstable multivariable zeros
- ▶ Decentralized/decoupled control by pairing of signals
- ▶ Short warning on integral action in parallel systems

Rosenbrock's Example

There is a nice collection of linear multivariable systems with interesting properties. Here is one of them

$$P(s) = \begin{pmatrix} \frac{1}{s+1} & \frac{2}{s+3} \\ \frac{1}{s+1} & \frac{1}{s+1} \end{pmatrix}$$

Very benign subsystems (compare with example in [G&L, Ch.1]).

The transmission zeros are given by

$$\det P(s) = \frac{1}{s+1} \left(\frac{1}{s+1} - \frac{2}{s+3} \right) = \frac{1-s}{(s+1)^2(s+3)} = 0.$$

Difficult to control the system with gain crossover frequencies larger than $\omega_{gc} = 0.5$.

Analysis

$$Y_1(s) = \frac{1}{(s+1)^2} U_1(s) + \frac{2}{(s+1)^2} U_2(s)$$

$$Y_2(s) = \frac{1}{(s+1)^2} U_1(s) + \frac{1}{(s+1)^2} U_2(s).$$

P-control of second loop $U_2(s) = -k_2 Y_2(s)$ gives

$$Y_1(s) = g_{11}^{cl}(s) U_1(s) = \frac{s^2 + 2s + 1 - k_2}{(s+1)^2(s^2 + 2s + 1 + k_2)} U_1(s).$$

The gain k_2 in the second loop has a significant effect on the dynamics in the first loop. The static gain is

$$g_{11}^{cl}(0) = \frac{1 - k_2}{1 + k_2}.$$

Notice that the gain decreases with increasing k_2 and becomes negative for $k_2 > 1$.

RGA / Bristol's Relative Gain

Consider the first loop $u_1 \rightarrow y_1$ when the second loop is in perfect control ($y_2 = 0$)

$$\begin{aligned} Y_1(s) &= p_{11}(s) U_1(s) + p_{12} U_2(s) \\ 0 &= p_{21}(s) U_1(s) + p_{22} U_2(s). \end{aligned}$$

Eliminating $U_2(s)$ from the first equation gives


$$Y_1(s) = \frac{p_{11}(s)p_{22}(s) - p_{12}(s)p_{21}(s)}{p_{22}(s)} U_1(s).$$

The ratio of the static gains of loop 1 when the second loop is open and closed is

$$\lambda = \frac{p_{11}(0)p_{22}(0)}{p_{11}(0)p_{22}(0) - p_{12}(0)p_{21}(0)}.$$

Parameter λ is called Bristol's interaction index

Interaction of Simple Loops

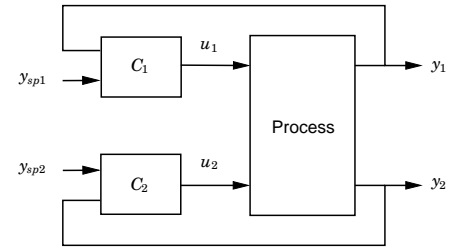


$$Y_1(s) = p_{11}(s)U_1(s) + p_{12}U_2(s)$$

$$Y_2(s) = p_{21}(s)U_1(s) + p_{22}U_2(s),$$

What happens when the controllers are tuned individually?

An Example

Controller C_1 is a PI controller with gains $k_1 = 1$, $k_i = 1$, and the C_2 is a proportional controller with gains $k_2 = 0, 0.8$, and 1.6 .

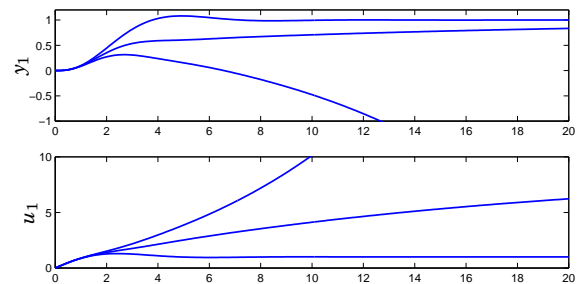

The second controller has a major impact on the first loop!

RGA / Bristol's Relative Gain

- ▶ A simple way of measuring interaction based on static properties
- ▶ Edgar H. Bristol, "On a new measure of interaction for multivariable process control", [IEEE TAC 11(1967) pp. 133–135]
- ▶ Idea: What is effect of control of one loop on the steady state gain of another loop?
- ▶ Consider one loop when the other loop is under perfect control

$$Y_1(s) = p_{11}(s)U_1(s) + p_{12}U_2(s)$$


$$0 = p_{21}(s)U_1(s) + p_{22}U_2(s).$$

Many Loops

Assume n inputs and n outputs. Pick an input output pair and relabel so that the input is y_1 , let the remaining outputs be $y_2 = 0$. Let the input be u_2 and the remaining inputs be u_1 .

$$y_1 = p_{11}u_1 + p_{12}u_2$$

$$0 = p_{21}u_1 + p_{22}u_2$$



Solving for y_1 gives

$$y_1 = (p_{12} - p_{11}p_{21}^{-1}p_{22})u_2, \quad r_{12} = \frac{p_{12}}{(p_{12} - p_{11}p_{21}^{-1}p_{22})^{-1}}$$

Compare

$$P = \begin{pmatrix} p_{11} & p_{12} \\ p_{21} & p_{22} \end{pmatrix}, \quad P^{-1} = \begin{pmatrix} \cdots & \cdots \\ (p_{12} - p_{11}p_{21}^{-1}p_{22})^{-1} & \cdots \end{pmatrix}$$

The relative gain array is $R = P \star P^{-T}$

Bristol's Relative Gain Array (RGA)

Let $P(s)$ be an $n \times n$ matrix of transfer functions. The relative gain array is

$$\Lambda = P(0) \star P^{-T}(0)$$


The product \star is "element-by-element product" (Schur or Hadamard product, same notation in matlab). Properties

- ▶ $(A \star B)^T = A^T \star B^T$
- ▶ P diagonal or triangular gives $\Lambda = I$
- ▶ Not effected by diagonal scalings

Insight and use

- ▶ A measure of static interactions for square systems which tells how the gain in one loop is influenced by perfect feedback on all other loops
- ▶ Dimension free. Row and column sums are 1.
- ▶ Negative elements correspond to sign reversals due to feedback of other loops

Step Responses with Reverse Pairing

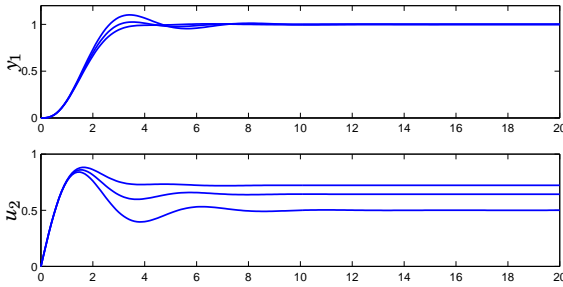

- ▶ $U_2 = \left(1 + \frac{1}{s}\right)(Y_{ref1} - Y_1)$
- ▶ $u_1 = -k_2 y_2$ with $k_2 = 0, 0.8$, and 1.6 .

Extra: Singular Values

Let A be an $k \times n$ matrix whose elements are complex variables. The singular value decomposition of the matrix is

$$A = U \Sigma V^*$$

where $*$ denotes transpose and complex conjugation, U and V are unitary matrices ($UU^* = I$ and $VV^* = I$). The matrix Σ is a $k \times n$ matrix such that $\Sigma_{ii} = \sigma_i$ and all other elements are zero. The elements σ_i are called singular values. The largest $\bar{\sigma} = \max_i \sigma_i$ and smallest $\underline{\sigma} = \min_i \sigma_i$ singular values are of particular interest. The number $\bar{\sigma}/\underline{\sigma}$ is called the condition number. The singular values are the square roots of the eigenvalues of A^*A .

Example: A real 2×2 matrix can be written as

$$A = \begin{pmatrix} \cos \theta_1 & -\sin \theta_1 \\ \sin \theta_1 & \cos \theta_1 \end{pmatrix} \begin{pmatrix} \sigma_1 & 0 \\ 0 & \sigma_2 \end{pmatrix} \begin{pmatrix} \cos \theta_2 & \sin \theta_2 \\ -\sin \theta_2 & \cos \theta_2 \end{pmatrix}$$

Extra: Interaction Analysis

Consider a system with the scaled zero frequency gain

$$\begin{pmatrix} y_1 \\ y_2 \\ y_3 \end{pmatrix} = \begin{pmatrix} 0.48 & 0.90 & -0.006 \\ 0.52 & 0.95 & 0.008 \\ 0.90 & -0.95 & 0.020 \end{pmatrix} \begin{pmatrix} u_1 \\ u_2 \\ u_3 \end{pmatrix}$$

Relative gain array

$$\Lambda = \begin{pmatrix} 0.7100 & -0.1602 & 0.4501 \\ -0.3557 & 0.7925 & 0.5632 \\ 0.6456 & 0.3677 & -0.0133 \end{pmatrix}$$

Singular values: $\sigma_1 = 1.6183$, $\sigma_2 = 1.1434$ and $\sigma_3 = 0.0097$. Condition number $\kappa = 166$. Only two outputs can be controlled in practice. What variables should be chosen?

Pairing

When designing complex systems loop by loop we must decide what measurements should be used as inputs for each controller. This is called the pairing problem. The choice can be governed by physics but the relative gain can also be used

Consider the previous example

$$P(0) = \begin{pmatrix} 1 & 2 \\ 1 & 1 \end{pmatrix}, \quad P^{-1}(0) = \begin{pmatrix} -1 & 2 \\ 1 & -1 \end{pmatrix}$$

$$\Lambda = P(0) \star P^{-T}(0) = \begin{pmatrix} -1 & 2 \\ 2 & -1 \end{pmatrix}$$

- ▶ Negative sign indicates the sign reversal found previously
- ▶ Better to use reverse pairing, i.e. let u_2 control y_1

Summary for 2×2 Systems (RGA)

$\lambda = 1$ No interaction

$\lambda = 0$ Closed loop gain $u_1 \rightarrow y_1$ is zero. Avoid this.

$0 < \lambda < 1$ Closed loop gain $u_1 \rightarrow y_1$ is larger than open loop gain.

$\lambda > 1$ Closed loop gain $u_1 \rightarrow y_1$ is smaller than open loop gain. Interaction increases with increasing λ . Very difficult to control both loops independently if λ is very large.

$\lambda < 0$ The closed loop gain $u_1 \rightarrow y_1$ has different sign than the open loop gain. Opening or closing the second loop has dramatic effects. The loops are counteracting each other. Such pairings should be avoided for decentralized control and the loops should be controlled jointly as a multivariable system.

Extra: Singular Decomposition $A = U \Sigma V^*$

- ▶ The columns u_i of U represent the output directions
- ▶ The columns v_i of V represent the input directions
- ▶ We have $AV = U\Sigma$, or $Av_i = \sigma_i u_i$. An input in the direction v_i thus gives the output $\sigma_i u_i$, i.e. in the direction u_i
- ▶ Since the vectors u_i and v_i are of unit length the gain of A for the input u_i is σ_i
- ▶ The largest gain is $\bar{\sigma} = \max_i \sigma_i$
- ▶ There are efficient numerical algorithms `svd` in Matlab
- ▶ Singular values can be applied to nonsquare matrices
- ▶ A natural way to define gain for matrices A and transfer function matrices $G(s)$

$$\text{gain} = \max_v \frac{\|Av\|}{\|v\|} = \bar{\sigma}(A), \quad \text{gain} = \max_{\omega} \bar{\sigma}(G(i\omega))$$

Extra: Interaction Analysis

We have $y = U S V^T$. How to pick two input output pairs

$$SV^T = \begin{pmatrix} -0.088 & -1.616 & 0.010 \\ 1.142 & -0.062 & 0.018 \\ -0.000 & 0.000 & 0.010 \end{pmatrix} \quad U = \begin{pmatrix} -0.571 & 0.377 & -0.729 \\ -0.604 & 0.409 & 0.684 \\ 0.556 & 0.831 & -0.007 \end{pmatrix}$$

The matrix SV^T shows that u_1 and u_2 are obvious choices of inputs. As far as the outputs are concerned. We have two choices y_1, y_3 or y_2, y_3 (angles between rows). Notice that y_1, y_2 is not a good choice because the corresponding rows of US are almost parallel. The singular values are

Selection $y_1, y_3 \leftarrow u_1, u_2$ Condition number $\kappa = 1.51$

Selection $y_2, y_3 \leftarrow u_1, u_2$ Condition number $\kappa = 1.45$

$$\Lambda = \begin{pmatrix} 0.3602 & 0.6398 \\ 0.6398 & 0.3602 \end{pmatrix}$$

$$\Lambda = \begin{pmatrix} 0.3662 & 0.6338 \\ 0.6338 & 0.3662 \end{pmatrix}$$

Interactions Can be Beneficial

$$P(s) = \begin{pmatrix} p_{11}(s) & p_{12}(s) \\ p_{21}(s) & p_{22}(s) \end{pmatrix} = \begin{pmatrix} \frac{s-1}{(s+1)(s+2)} & \frac{s}{(s+1)(s+2)} \\ -6 & \frac{s-2}{(s+1)(s+2)} \end{pmatrix}$$

The relative gain array

$$R = \begin{pmatrix} 1 & 0 \\ 0 & 1 \end{pmatrix}$$

Transmission zeros

$$\det P(s) = \frac{(s-1)(s-2) + 6s}{(s+1)^2(s+2)^2} = \frac{s^2 + 4s + 2}{(s+1)^2(s+2)^2}$$

Difficult to control individual loops fast because of the zero at $s = 1$. Since there are no multivariable zeros in the RHP the multivariable system can easily be controlled fast but this system is not robust to loop breaks.

Transfer Function of Linearized Model

Transfer function from u_1, u_2 to y_1, y_2

$$P(s) = \begin{pmatrix} \frac{\gamma_1 c_1}{1 + sT_1} & \frac{(1 - \gamma_2)c_1}{(1 + sT_1)(1 + sT_3)} \\ \frac{(1 - \gamma_1)c_2}{(1 + sT_2)(1 + sT_4)} & \frac{\gamma_2 c_2}{1 + sT_2} \end{pmatrix}$$

Transmission zeros

$$\det P(s) = \frac{(1 + sT_3)(1 + sT_4) - \frac{(1 - \gamma_1)(1 - \gamma_2)}{\gamma_1 \gamma_2}}{(1 + sT_1)(1 + sT_2)(1 + sT_3)(1 + sT_4)}$$

- ▶ No interaction of $\gamma_1 = \gamma_2 = 1$
- ▶ Minimum phase if $1 \leq \gamma_1 + \gamma_2 \leq 2$
- ▶ Nonminimum phase if $0 < \gamma_1 + \gamma_2 \leq 1$.
- ▶ Intuition?



A multivariable control problem

-The water is too cold! -Now it is too hot! -Now it is too cold! -Now it is too deep!



How to do if we want to separate control of

- ▶ temperature?
- ▶ water level?




Find D_1 and D_2 so that the controller sees a "diagonal plant":

$$D_2 P D_1 = \begin{bmatrix} * & 0 & 0 \\ 0 & * & 0 \\ 0 & 0 & * \end{bmatrix}$$

Then we can use a "decentralized" controller C with same block-diagonal structure.

The Quadruple Tank

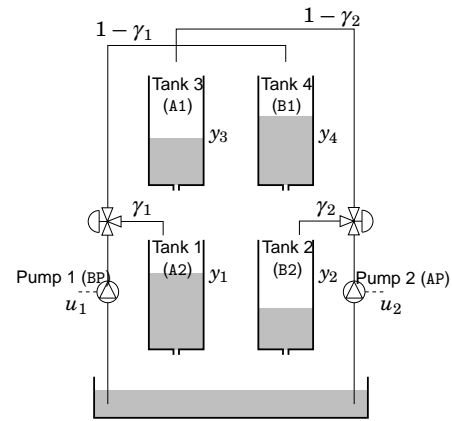

Relative Gain Array

Zero frequency gain matrix

$$P(0) = \begin{pmatrix} \gamma_1 c_1 & (1 - \gamma_2)c_1 \\ (1 - \gamma_1)c_2 & \gamma_2 c_2 \end{pmatrix}$$

The relative gain array

$$P(0) = \begin{pmatrix} \lambda & 1 - \lambda \\ 1 - \lambda & \lambda \end{pmatrix}$$

where

$$\lambda = \frac{\gamma_1 \gamma_2}{\gamma_1 + \gamma_2 - 1}$$

- ▶ No interaction for $\gamma_1 = \gamma_2 = 1$
- ▶ Severe interaction if $\gamma_1 + \gamma_2 < 1$

Decoupling

Simple idea: Find a compensator so that the system appears to be without coupling ("block-diagonal transfer function matrix").

Many versions – here we will consider

- ▶ Input decoupling $Q = P D_1$
- ▶ Output decoupling $Q = D_2 P$
- ▶ "both" $Q = D_2 P D_1$

but many different methods including

- ▶ Conventional (Feedforward)
- ▶ Inverse (Feedback)
- ▶ Static

Important to consider windup, manual control and mode switches.

- ▶ Keep the decentralized philosophy

The Quadruple Tank

Transfer function

$$P(s) = \begin{pmatrix} \frac{\gamma_1 c_1}{1 + sT_1} & \frac{(1 - \gamma_2)c_1}{(1 + sT_1)(1 + sT_3)} \\ \frac{(1 - \gamma_1)c_2}{(1 + sT_2)(1 + sT_4)} & \frac{\gamma_2 c_2}{1 + sT_2} \end{pmatrix}$$

Relative gain array

$$R = P(0) \cdot \star P(0)^{-1} = \begin{pmatrix} \lambda & 1 - \lambda \\ 1 - \lambda & \lambda \end{pmatrix}$$

where


$$\lambda = \frac{\gamma_1 \gamma_2}{\gamma_1 + \gamma_2 - 1}$$

Recall RHP zero if $\gamma_1 + \gamma_2 < 1$. Physical interpretation!

- ▶ Longitudinal
- ▶ Lateral

May be good to decouple interaction to outputs, but you should also be careful **not to waste control action** to “strange decouplings”!!

Systems with Parallel Actuation

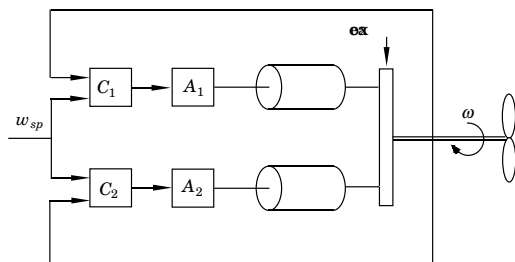


- ▶ Motor drives for papermachines and rolling mills
- ▶ Trains with several motors or several coupled trains
- ▶ Power systems

Integral Action?

What if we instead use two PI-controllers?

WARNING!!!

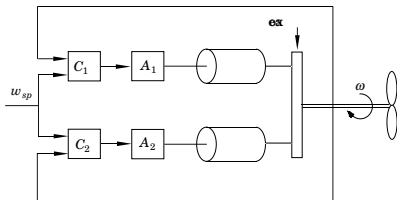

Prototypes for lack of controllability and observability!

Summary

- ▶ All real systems are coupled
- ▶ Multivariable zeros - limitations
 - ▶ Never forget process redesign
- ▶ Relative gain array and singular values give insight
- ▶ Why decouple
 - Simple system.
 - SISO design, tuning and operation can be used
 - What is lost?
- ▶ Parallel systems
 - One integrator only!
- ▶ Next lecture: Multivariable design LQ/LQG

- ▶ Transfer functions for MIMO-systems
- ▶ Limitations due to unstable multivariable zeros
- ▶ Decentralized/decoupled control by pairing of signals
- ▶ **Short warning on integral action in parallel systems**

A Prototype Example

$$J \frac{d\omega}{dt} + D\omega = M_1 + M_2 - M_L,$$

Proportional control

$$M_1 = M_{10} + K_1(\omega_{sp} - \omega)$$

$$M_2 = M_{20} + K_2(\omega_{sp} - \omega)$$


The proportional gains tell how the load is distributed

$$J \frac{d\omega}{dt} + (D + K_1 + K_2)\omega = M_{10} + M_{20} - M_L + (K_1 + K_2)\omega_{sp}.$$

A first order system with time constant $T = J/(D + K_1 + K_2)$

Discuss response speed, damping and steady state

$$\omega = \omega_0 = \frac{K_1 + K_2}{D + K_1 + K_2} \omega_{sp} + \frac{M_{10} + M_{20} - M_L}{D + K_1 + K_2}.$$

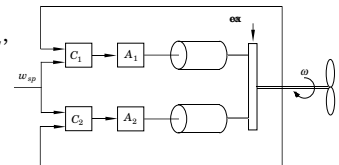

Power Systems - Massive Parallelism

- ▶ Edison's experience
 - Two generators with governors having integral action
- ▶ Many generators supply power to the net.
 - Frequency control
 - Voltage control
- ▶ Isochronous governors (integral action) and governors with speed-drop (no integral action)

